

84th FLOOR PLAN

DISCONNECT & REMOVE EXISTING PLUG IN FUSED SWITCHES AND REPLACE WITH PLUG IN CIRCUIT BREAKERS. (SEE BUSWAY SWITCH REPLACEMENT SCHEDULE, THIS DWG). TURN OVER PLUG IN FUSED SWITCHES TO THE PORT AUTHORITY.

SPECIAL OFFSET CABLE TAP BOX IN HUNG CEILING AREA

CEILING CONSTRUCTION


SHEETROCK

EXISTING DOOR


1600A, 480/277V ALUMINUM, PAIRED PHASE BUSWAY TO MATCH EXISTING FEDERAL PACIFIC BUSWAY.

84th FLOOR SECTION A-A & PART RISER

BUSWAY SWITCH REPLACEMENT			
#	EXIST. SW. SIZE	EXIST. FUSE RATING	NEW BREAKER RATING
85S-1	200A	125A	225AF/125
68S-1	200A	125A	225AF/125
65S-1	200A	125A	225AF/125

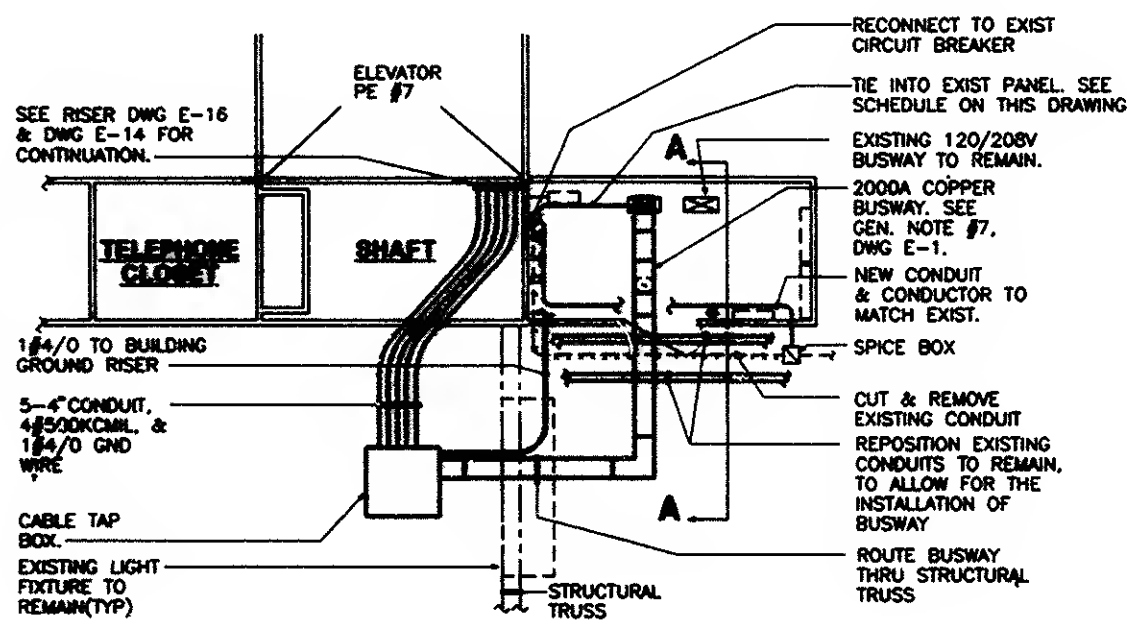

65th FLOOR PLAN

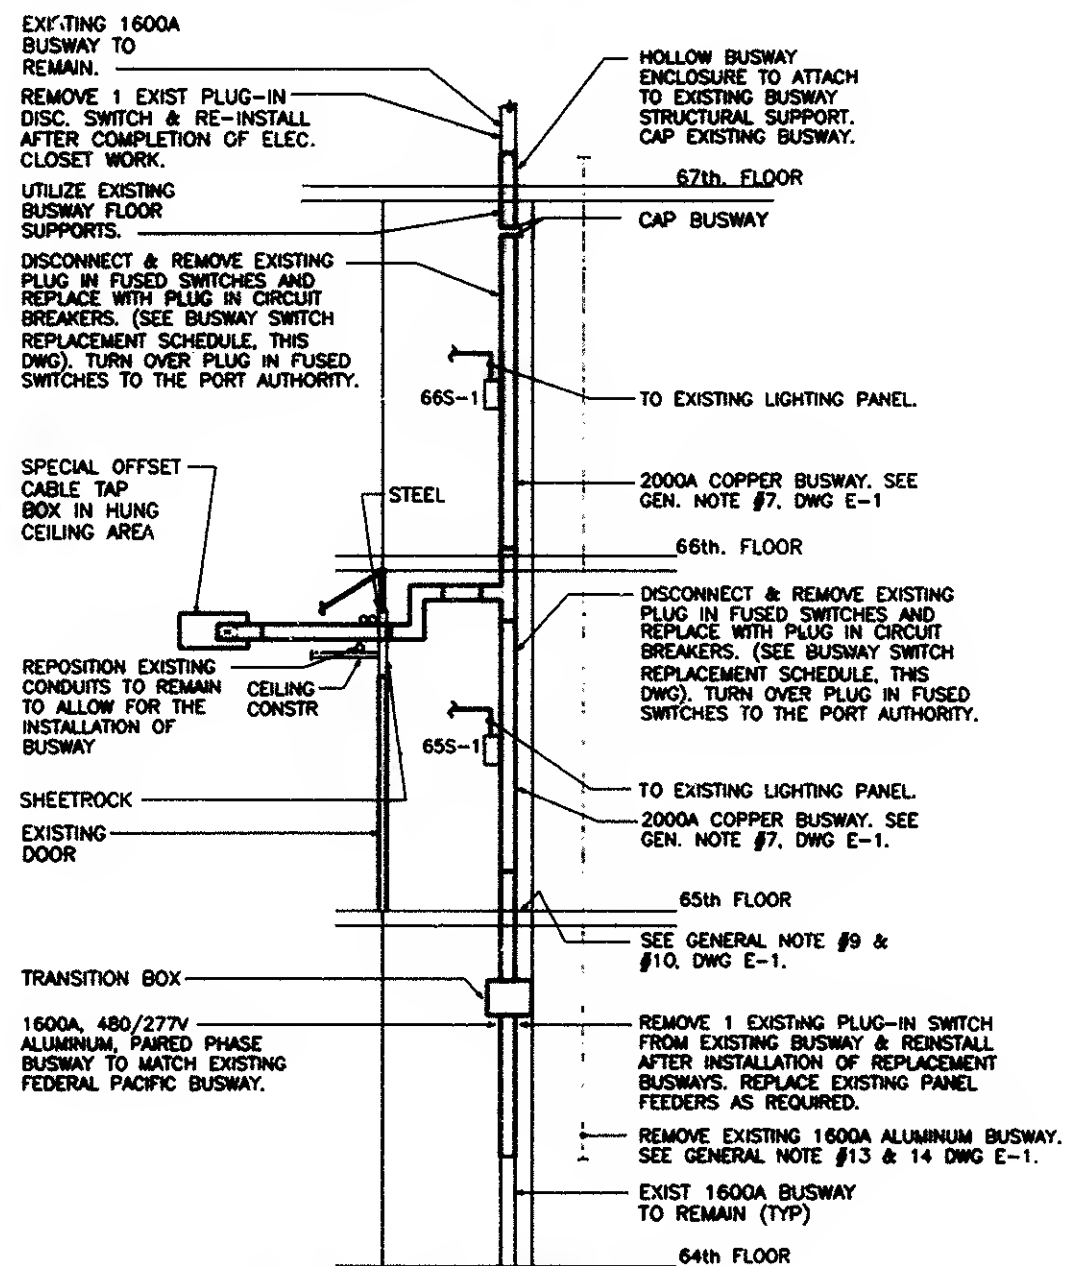

65th FLOOR SECTION A-A & PART RISER

SHAFT & ELEC. CL. AREAS

WORK AREA